

202220" 8E94800T


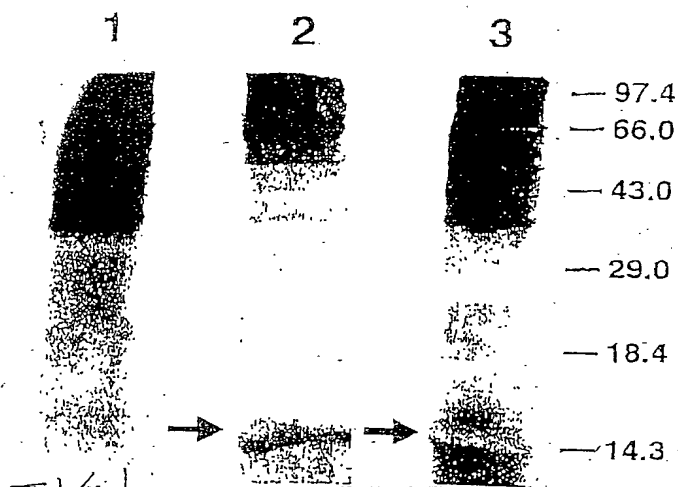


Fig 1.

204230-8594800T

FIG. 2

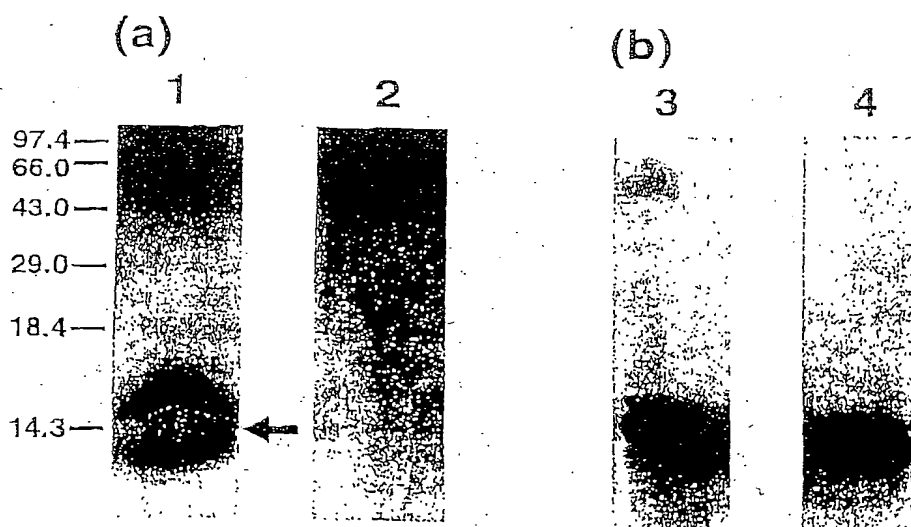

10084638 .022702

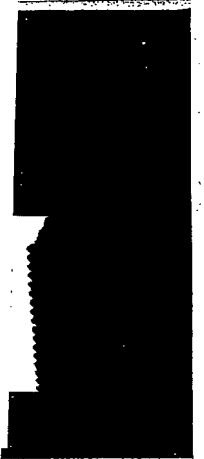
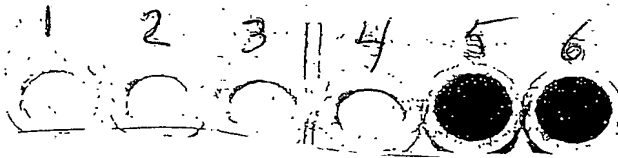


FIG. 3

2022082800T 10084638.022702

	BME			
CONTROL	+	7.04 ± 1.39	14.49 ± 0.63**	
SERUM (+)	+	7.41 ± 0.93	9.17 ± 0.42**	
SERUM (+)	+	8.77 ± 0.77	15.38 ± 2.84**	
SERUM (+)	+	7.54 ± 1.22	19.81 ± 4.61**	Background
SERUM (-)		4.46 ± 0.14	5.57 ± 0.53*	4.83 ± 0.47

Fig. 4

2022018E94800F

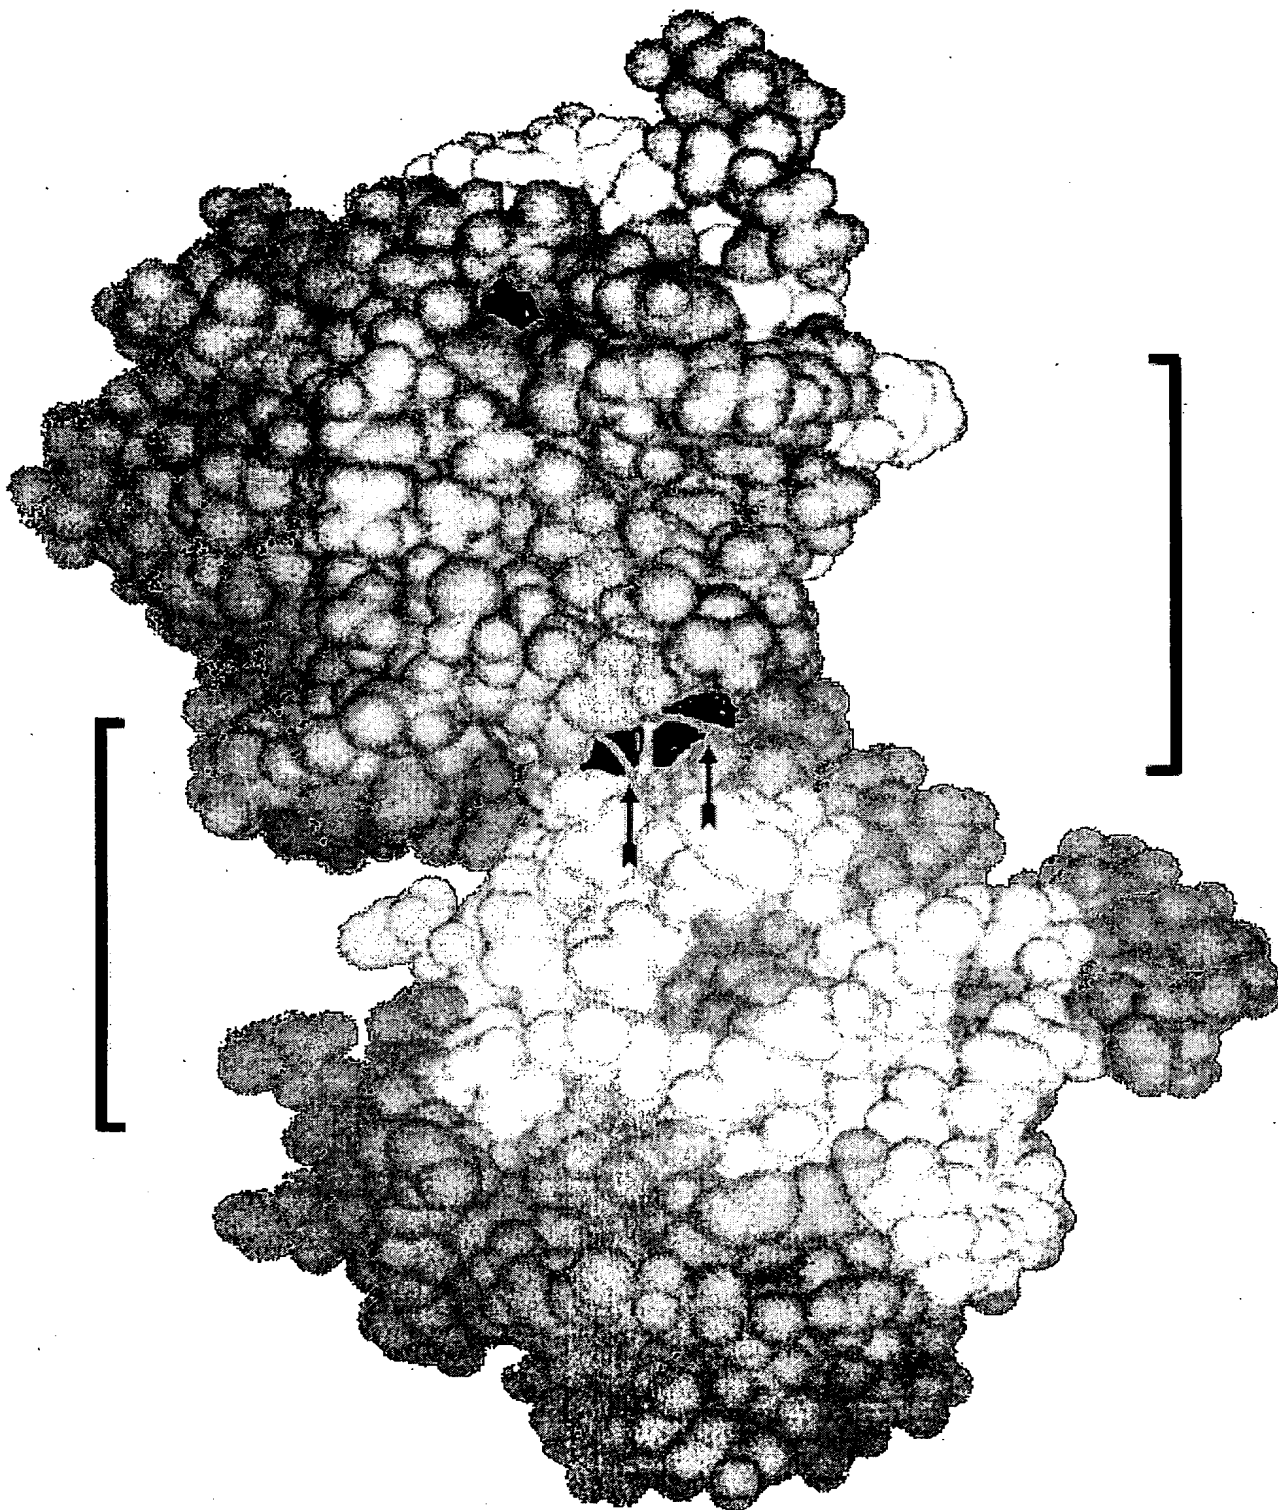


FIG. 5